



# ApogeeConnects : Rosetta 800 - MiniDAC - Digi 002, 001

## Hardware Connections

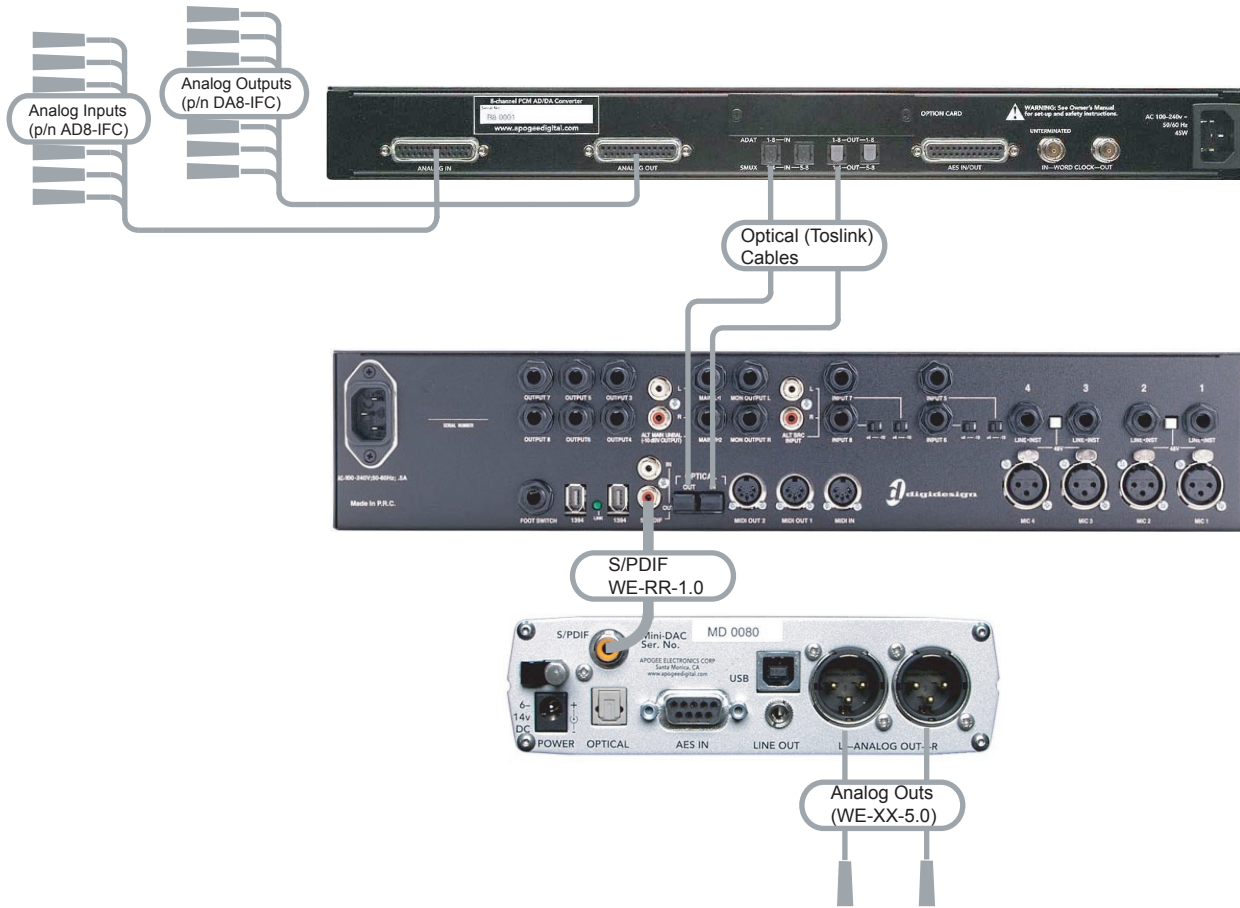

## Hardware Settings

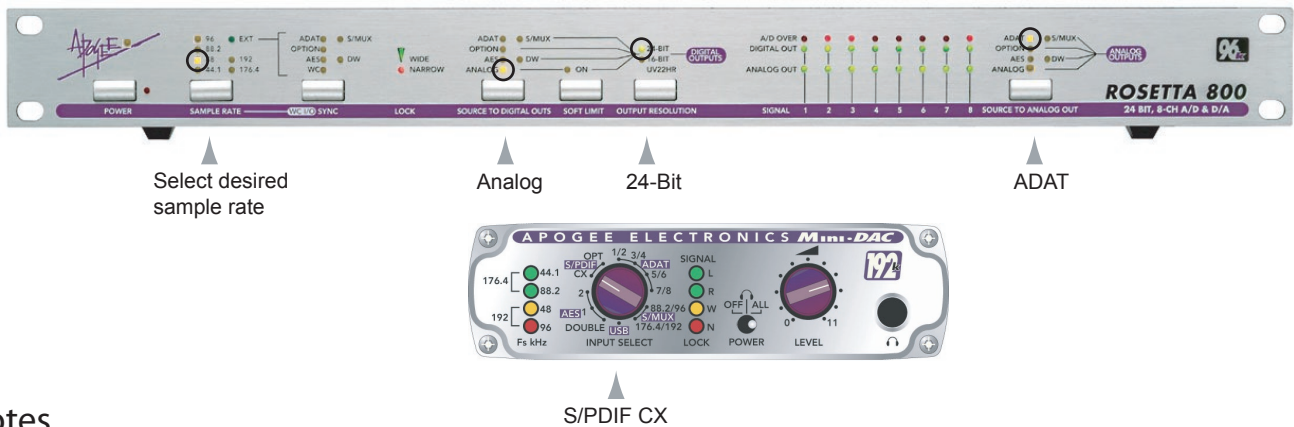

## Notes

- 1) The 002's ADAT I/O supports sample rates up to 48 kHz.
- 2) In the Pro Tools software, under **Hardware Setup**, set **Clock Source** to **ADAT**.
- 3) In Pro Tools, select inputs **ADAT 1-8** to receive signals from the Rosetta 800's analog inputs; select outputs **ADAT 1-8** to send signals to the Rosetta's analog outputs.
- 4) In Pro Tools, select the **S/PDIF** output to send signals to the MiniDAC's analog outputs.